


## SLAMBLOCK CHECK VALVE SUBMITTAL

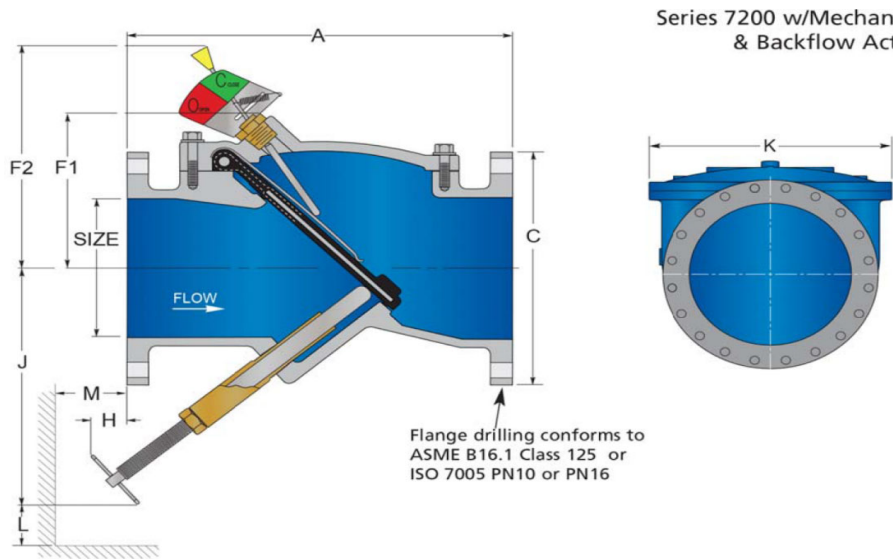

Valve Size	CWP	Base Valve					with Indicator	with Backflow Actuator				Wt	
		Model No.	A	C	F1	K	F2	H	J	L	M		
(in)	(psi)		(in)	(in)	(in)	(in)	(in)	(in)	(in)	(in)	(in)	(lbs)	(lbs)
2	250	7202	8.00	6.00	3.38	5.18	-	-0.50	6.75	1.5	2	-	
2 1/2	250	7225	8.50	7.00	3.38	5.18	-	-0.50	7.00	1.5	1.5	-	
3	250	7203	9.50	7.50	5.13	7.50	8.88	-0.38	7.50	2	2	-	
4	250	7204	11.50	9.00	5.75	8.25	9.50	3.38	10.75	3	3	-	
6	250	7206	14.00	11.00	6.88	11.13	10.63	1.38	11.38	3	3	-	
8	250	7208	19.50	13.50	8.38	16.00	12.25	2.00	15.75	6	6	-	
10	250	7210	24.50	16.00	10.75	21.00	14.63	0.50	17.00	6	6	-	
12	250	7212	27.50	19.00	12.50	24.00	16.25	3.50	22.50	7	7	-	
14	250	7214	31.00	21.00	13.00	23.25	18.88	4.00	26.25	7	7	-	
16	250	7216	36.00	23.50	14.25	25.25	20.13	4.63	30.00	7	7	-	
18	250	7218	40.00	25.00	15.25	28.25	21.25	5.25	33.75	7	7	-	
20	250	7220	40.00	27.50	16.88	30.63	22.63	5.88	37.50	8	8	-	
24	250	7224	48.00	32.00	19.25	36.00	25.13	1.81	45.00	8	8	-	
30	150	7230	56.00	38.75	23.00	45.88	28.88	-0.63	41.25	8.00	8.00	-	
	250	7230A											
36	150	7236	63.00	46.00	27.38	55.00	32.25	-0.38	49.00	9.75	9.75	-	
	250	7236A											
42	150	7242	70.00	53.00	36.88	60.18	40.37	-5.50	53.50	9.75	9.75	-	
	250	7242A											
48	150	7248	76.00	59.50	40.66	68.00	43.41	-2.90	41.98	10.00	10.00	-	
	250	7248A											

\* Dimension "N" with negative numbers extend past bottom of integral mounting pads (flange feet).

CUSTOMER _____ PROJECT _____ ENGINEER _____ CONTRACTOR _____ CERTIFICATION _____	
MODEL: _____ DRAWN BY: _____ PDB 3/22/20	<b>SLAMBLOCK</b>  <b>STAYFLOW</b> <b>CHECK VALVES</b>